

इंटरनेट

मानक

Disclosure to Promote the Right To Information

Whereas the Parliament of India has set out to provide a practical regime of right to information for citizens to secure access to information under the control of public authorities, in order to promote transparency and accountability in the working of every public authority, and whereas the attached publication of the Bureau of Indian Standards is of particular interest to the public, particularly disadvantaged communities and those engaged in the pursuit of education and knowledge, the attached public safety standard is made available to promote the timely dissemination of this information in an accurate manner to the public.

“जानने का अधिकार, जीने का अधिकार”

Mazdoor Kisan Shakti Sangathan

“The Right to Information, The Right to Live”

“पुराने को छोड़ नये के तरफ”

Jawaharlal Nehru

“Step Out From the Old to the New”

IS 4111-2 (1985): Code of practice for ancillary structures in sewerage system, Part II: Flusing tanks [CED 24: Public Health Engineering.]



“ज्ञान से एक नये भारत का निर्माण”

Satyanarayan Gangaram Pitroda

“Invent a New India Using Knowledge”



“ज्ञान एक ऐसा खजाना है जो कभी चुराया नहीं जा सकता है”

Bhartrhari—Nitiśatakam

“Knowledge is such a treasure which cannot be stolen”

BLANK PAGE



IS : 4111 (Part 2) - 1985


Indian Standard

CODE OF PRACTICE FOR
ANCILLARY STRUCTURES IN
SEWERAGE SYSTEM

PART 2 FLUSHING TANKS

(*First Revision*)

UDC 628.282 : 006.76



© Copyright 1986

INDIAN STANDARDS INSTITUTION
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002

Indian Standard
**CODE OF PRACTICE FOR
ANCILLARY STRUCTURES IN SEWERAGE SYSTEM**

PART 3 INVERTED SYPHON

(First Revision)

Water Supply and Sanitation Sectional Committee, BDC 24

Chairman

SHRI J. D'Cruz

Representing

Water Supply and Sewage Disposal Undertaking, New Delhi

Members

CHIEF ENGINEER (CIVIL I) (*Alternate to*

Shri J. D'Cruz)

ADVISED (PHE)

Ministry of Works and Housing, New Delhi

DEPUTY ADVISER (PHE) (*Alternate*)

SHRI M. S. ASNANI

Public Works Department (Delhi Administration), New Delhi

SHRI P. C. SRIVASTAVA (*Alternate*)

SHRI AVDRESH KUMAR

Tata Consulting Engineers, Bangalore

SHRI S. CHANDRA (*Alternate*)

SHRI N. S. BHAIKAVAN

Public Health Engineering Department, Trivandrum

SUPERINTENDING ENGINEER (*Alternate*)

SHRI I. CHANDRA

Haryana PWD, Public Health Branch, Chandigarh

SHRI K. K. GANDHI (*Alternate*)

CHIEF ENGINEER (CONSTRUCTION) Uttar Pradesh Jal Nigam, Lucknow

SUPERINTENDING ENGINEER (*Alternate*)

SHRI R. C. P. CHOUDHARY

Engineers India Ltd, New Delhi

SHRI H. V. RAO (*Alternate*)

SHRI S. K. DASGUPTA

Calcutta Metropolitan Development Authority, Calcutta

SHRI S. R. MUKHERJEE (*Alternate*)

PROF J. M. DAVE

Institution of Engineers (India), Calcutta

(*Continued on page 2*)

© Copyright 1986

INDIAN STANDARDS INSTITUTION

This publication is protected under the *Indian Copyright Act (XIV of 1957)* and reproduction in whole or in part by any means except with written permission of the publisher shall be deemed to be an infringement of copyright under the said Act.

IS : 4111 (Part 2) - 1985

(Continued from page 1)

<i>Members</i>	<i>Representing</i>
SHRI S. G. DEOLALIKAR	In personal capacity (Flat No. 403, Savitri Cinema Commercial Complex, New Delhi)
SHRI DEVENDRA SINGH	In personal capacity (16-A Maya Mahal, 17th Road, Khar, Bombay)
HYDRAULIC ENGINEER	Municipal Corporation of Greater Bombay, Bombay
CHIEF ENGINEER (SEWERAGE PROJECTS) (<i>Alternate</i>)	
SHRI R. A. KHANNA	Public Health Department, Government of Madhya Pradesh, Bhopal
SHRI D. K. MITRA (<i>Alternate I</i>)	
SHRI I. S. BAWEJA (<i>Alternate II</i>)	
SHRI S. R. KSHIRSAGAR	National Environmental Engineering Research Institute (CSIR), Nagpur
DR P. V. R. C. PANICKER (<i>Alternate</i>)	
SHRI M. Y. MADAN	Hindustan Construction Co Ltd, Bombay
SHRI C. E. S. RAO (<i>Alternate</i>)	
SHRI S. L. MAINI	Punjab Public Works Department, Patiala
MANAGING DIRECTOR	Punjab Water Supply and Sewerage Board, Chandigarh
SHRI R. NATARAJAN	Hindustan Dorr-Oliver Ltd, Bombay
SHRI SUBHASH VERMA (<i>Alternate</i>)	
PROF K. J. NATH	All India Institute of Hygiene and Public Health, Calcutta
SHRI D. GUIN (<i>Alternate</i>)	
SHRI A. PONNAMBALAM	Tamil Nadu Water Supply and Drainage Board, Madras
PROF Y. N. RAMACHANDRA RAO	Ministry of Defence, Army Headquarters.
MAJ B. S. PARMAR (<i>Alternate</i>)	
SHRI RANJIT SINGH	Ministry of Railways, New Delhi
DR A. V. R. RAO	National Buildings Organization, New Delhi
SHRI O. P. RATRA (<i>Alternate</i>)	
REPRESENTATIVE	Madras Metropolitan Water Supply and Sewerage Board, Madras
SHRI S. DAIVAMANI (<i>Alternate</i>)	
SECRETARY	Indian Water Works Association, Bombay
SECRETARY GENERAL	Institution of Public Health Engineers India, Calcutta
SHRI R. N. BANERJEE (<i>Alternate</i>)	
SHRI L. R. SEHGAL	L. R. Sehgal and Co , New Delhi
SHRI S. K. SHARMA	Central Building Research Institute (CSIR), Roorkee
SUPERINTENDING SURVEYOR OF WORKS (NDZ)	Central Public Works Department, New Delhi
SURVEYOR OF WORKS-1 (NDZ) (<i>Alternate</i>)	
SHRI B. N. THYAGARAJA	Bangalore Water Supply and Sewerage Board, Bangalore
SHRI H. S. PUTTAKEMPANNA (<i>Alternate</i>)	
SHRI G. RAMAN, Director (Civ Engg)	Director General, ISI (<i>Ex-officio Member</i>)
	<i>Secretary</i>
	SHRI A. K. AVASTHY
	Deputy Director (Civ Engg), ISI

(Continued on page 9)

Indian Standard

CODE OF PRACTICE FOR ANCILLARY STRUCTURES IN SEWERAGE SYSTEM

PART 2 FLUSHING TANKS

(First Revision)

0. FOREWORD

0.1 This Indian Standard (First Revision) was adopted by the Indian Standards Institution on 29 November 1985, after the draft finalized by the Water Supply and Sanitation Sectional Committee had been approved by the Civil Engineering Division Council.

0.2 As far as possible sewerage system should be designed on the basis of self cleaning velocity. Stress should be laid on proper design and provision of proper gradients. However, in certain situations, it may become absolutely necessary to provide for flushing of sewers at periodical intervals to remove settled silt and sludge and flushing tanks are invariably used for such purposes.

0.3 This standard was formulated to cover ancillary structures in sewerage system. This standard first prepared in 1967 was intended to provide guidance to local bodies, public health engineering departments and others engaged in this field for the proper design and construction of flushing tanks. The important changes made in this revision are given below:

- a) Guidance for the location of flushing tank have been given in detail,
- b) Design consideration have been elaborated, and
- c) Details of special flushing tanks have been included.

0.4 The other parts of the standard (IS : 4111) are given below:

IS : 4111 (Part 1)-1986 Code of practice for ancillary structures in sewerage system: Part 1 Manholes

IS : 4111 (Part 3)-1985 Code of practice for ancillary structures in sewerage system: Part 3 Inverted syphon (*first revision*)

IS : 4111 (Part 4)-1968 Code of practice for ancillary structures in sewerage systems: Part 4 Pumping stations and pumping mains (rising mains)

0.5 For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the result of a test or analysis, shall be rounded off in accordance with IS : 2-1960*. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

1. SCOPE

1.1 This standard (Part 2) covers the requirements for location, design considerations and safeguards to be adopted for flushing tanks used in sewerage system.

2. TERMINOLOGY

2.0 For the purpose of this standard the following definitions shall apply.

2.1 Flushing Tank — An independent tank or chamber in which water is stored and discharged into sewer at intervals for flushing sewer.

2.2 Self Cleaning Velocity — A minimum velocity which prevents deposition of any solid matter in the sewers.

3. LOCATION

3.1 Flushing tanks shall be provided in such sections of the sewers where flow is never sufficient to generate self cleaning velocity. They may be located at heads of sewers (main or branch) or even intermediate points of the sewers.

4. DESIGN CONSIDERATIONS

4.1 General — Where it is not practicable to obtain gradient in the sewers, steep enough to give a self cleansing velocity of not less than 0.75 m/s, it requires to be flushed occasionally to prevent deposition and clogging and flushing water tanks are provided at suitable points on such sewer lines.

Under the effect of flush, a higher velocity is attained which is capable of dislodging the deposited clay, mud and other solids sticking to the side of sewer.

4.2 Quantity and Velocity of the Flush Water — For pipes under 600 mm diameter, the quantity of flushing water should be sufficient to fill

*Rules for rounding off numerical values (revised).

the sewer at least half-bore over the whole length of sewer to be flushed or from one flush point to the next. The head at which the flush is discharged should give an initial velocity much higher than the self-cleansing velocity, so as to ensure that solids already deposited will be removed. The approximate quantity of flushing water per flush over a length of 75 m to 90 m are as follows:

<i>Diameter of Pipe</i> (mm)	<i>Quantity of Water</i> (litres)
250	1 400 to 1 700
350	1 700 „ 2 700
400	2 700 „ 3 600
450	3 600 „ 4 500

4.3 Methods of Flushing and Type of Flushing Devices — Among the more usual ways of flushing sewers are the following:

- The construction of a special flushing tank at suitable points in sewer line. The special flushing tank may be either a manually operated or an automatic.
- The controlled admission of a limited amount of surface water into sewer line at required point.
- An extemporised flap valve or plug in a manhole at the lower end of sewer length to be flushed. This can also be achieved placing slots at the outlet side of an ordinary manhole to receive a wooden stop gate. Closing the gate will permit sewage to accumulate, and opening it will allow a rush of sewage to pass down the pipe.
- The use of a fire hose or a water tanker for which the appropriate fire authority and water undertaking should always be consulted.

4.4 Special Flushing Tanks — Manually operated and automatic flushing tanks, are given in 4.4.1 to 4.4.2.

4.4.1 Manually Operated Flushing Tank — It consists of a small independent chamber of masonry or concrete similar to a manhole of size enough to store water required for flushing the sewer once. It is connected with the manhole, in which flush is to be discharged. The diameter of connecting pipe should normally be the same as that of sewer to be flushed. It is provided with slots at the outlet side to receive a wooden stop gate to be operated manually. An overflow pipe is also provided beyond the required depth of water in this chamber, so as to avoid flooding the flushing tank if gate is not opened at appropriate time. A connection to the water supply system provides a small but constant

supply of water so regulated that the tank will fill at least once daily. A manually operated flushing tank is shown in Fig. 1.

4.4.2 Automatic Flushing Tank — An automatic flushing tank is shown in Fig. 2. It resembles a manhole but is equipped with a syphon placed in the bottom. A connection to the water supply system provides a small but constant supply of water so regulated that the tank will fill at least once daily. When tank is full, the syphon goes into operation and quickly discharges the water down the sewer. The quantity of flush will depend upon the diameter of sewer line to be flushed (see 4.2).

Adam's Syphon is one of such an automatic syphon, made of cast iron with trapped outlet for flushing. The syphon for flushing a sewer line shall be 65 mm, 80 mm or 100 mm diameter as specified.

4.4.2.1 Fixing of Adam's Syphon — Adam's Syphon shall be installed inside the masonry, concrete or RCC tank by using proper bolts, nuts and washers, etc, as required for the completion of the job. The joint in the tank and the syphon shall be leak proof. A typical section of a 100 mm diameter Adam's Syphon in a 3600 litres capacity tank is shown in Fig. 2. The Syphon when installed shall be tested to see that it functions smoothly and satisfactorily.

4.5 Period of Flushing — The period of flushing should normally be once in 24 hours.

5. SAFEGUARDS

5.1 Safeguard for Automatic Flushing Tank — Whenever an automatic flushing tank is provided, there shall be a physical break between supply connection and the maximum water level in the tank.


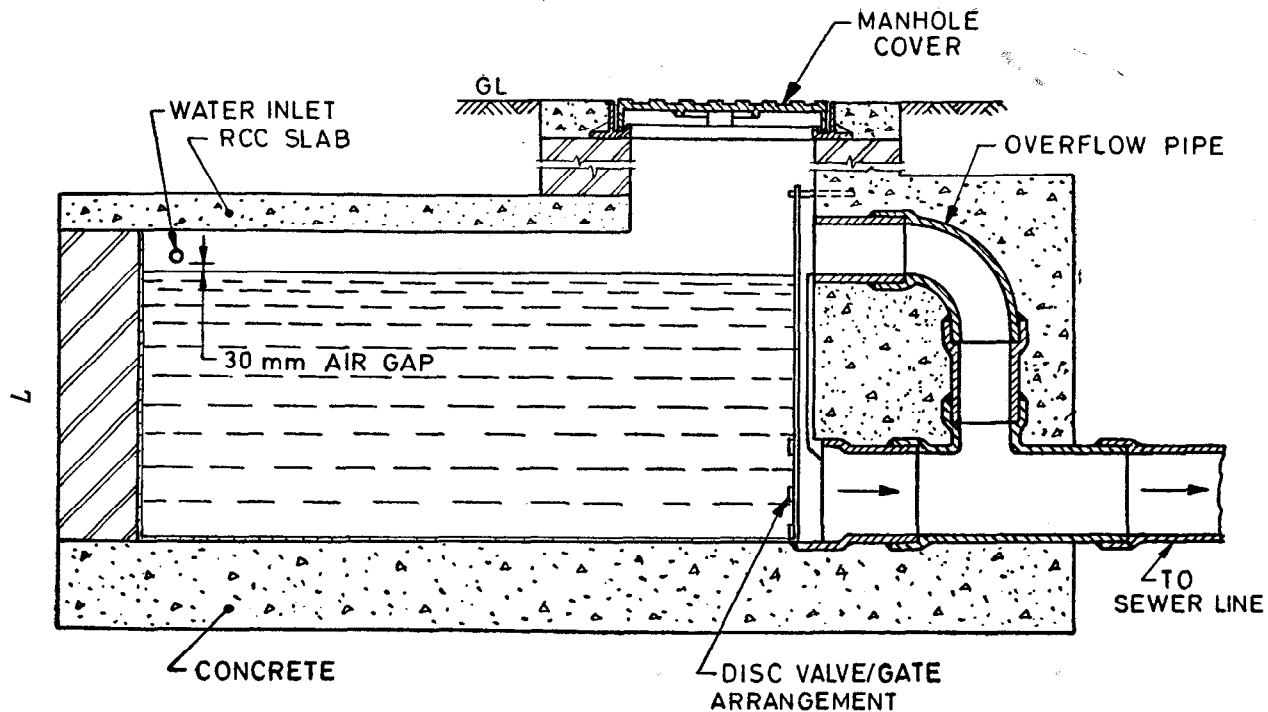


FIG. 1 TYPICAL ILLUSTRATION OF MANUALLY OPERATED FLUSHING TANK FOR SEWERS

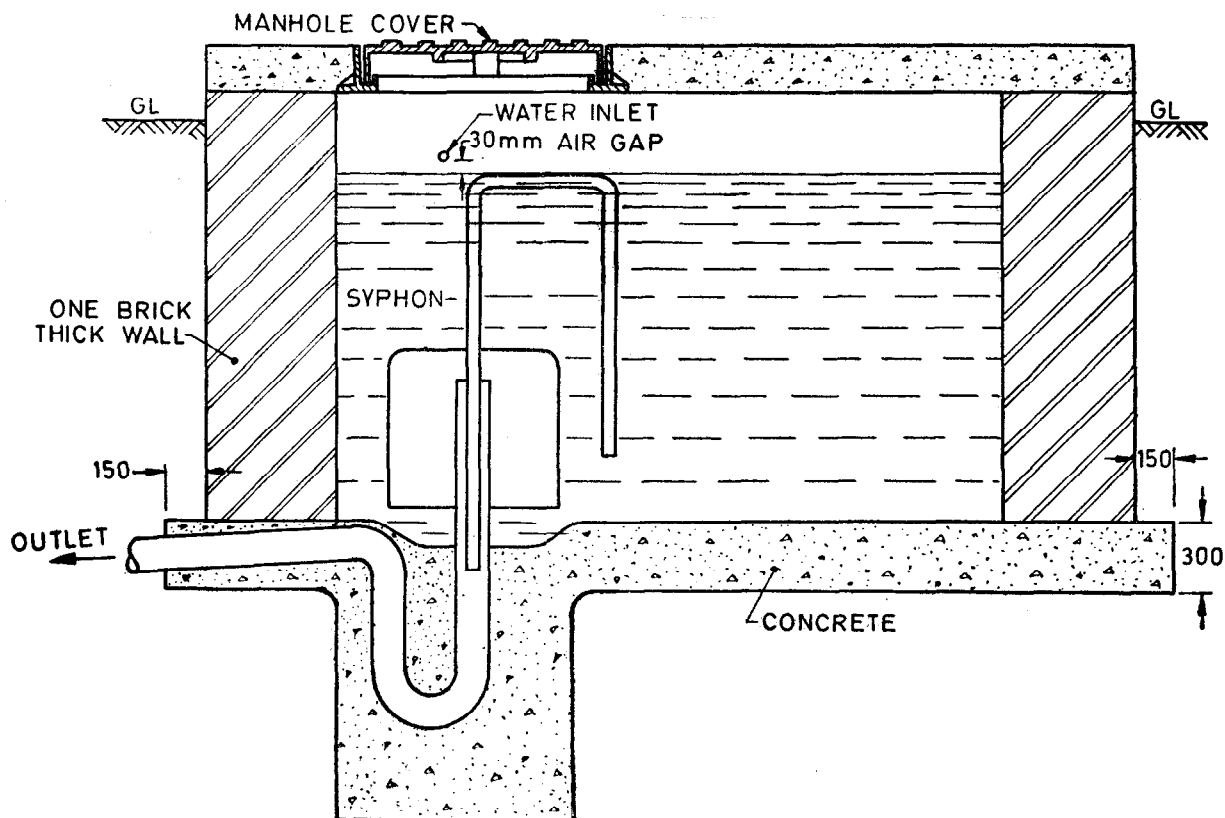

All dimensions in millimetres.

FIG. 2 TYPICAL ILLUSTRATION OF AUTOMATIC FLUSHING TANK FOR SEWERS

(Continued from page 2)

Composition of Drainage Subcommittee, BDC 24 : 2

Convener

SHRI P. G. JOSHI

Representing

Municipal Corporation of Greater Bombay,
Bombay

Members

DEPUTY CHIEF ENGINEER
(SEWERAGE) (Alternate to
Shri P. G. Joshi)

ADDITIONAL CHIEF ENGINEER
(WATER)

DEPUTY DRAINAGE ENGINEER
(Alternate)

CHIEF ENGINEER

DEPUTY ADVISOR (PHE)

SHRI DEVENDRA SINGH

SHRI K. GOVINDAN NAIR

SHRI A. PONNAMBALAM

SCIENTIST

SHRI A. W. DESHPANDE (Alternate)

SHRI S. K. SHARMA

Water Supply and Sewage Disposal Under-
taking, New Delhi

Public Works Department, Government of
Punjab, Patiala

Ministry of Works and Housing

In personal capacity (16-A Maya Mahal, 17th
Road, Khar, Bombay)

Public Health Engineering Department,
Trivandrum

Tamil Nadu Water Supply and Drainage Board,
Madras

National Environmental Engineering Research
Institute (CSIR), Nagpur

Central Building Research Institute (CSIR),
Roorkee

INTERNATIONAL SYSTEM OF UNITS (SI UNITS)

Base Units

<i>Quantity</i>	<i>Unit</i>	<i>Symbol</i>
Length	metre	m
Mass	kilogram	kg
Time	second	s
Electric current	ampere	A
Thermodynamic temperature	kelvin	K
Luminous intensity	candela	cd
Amount of substance	mole	mol

Supplementary Units

<i>Quantity</i>	<i>Unit</i>	<i>Symbol</i>
Plane angle	radian	rad
Solid angle	steradian	sr

Derived Units

<i>Quantity</i>	<i>Unit</i>	<i>Symbol</i>	<i>Definition</i>
Force	newton	N	1 N = 1 kg.m/s ²
Energy	joule	J	1 J = 1 N.m
Power	watt	W	1 W = 1 J/s
Flux	weber	Wb	1 Wb = 1 V.s
Flux density	tesla	T	1 T = 1 Wb/m ²
Frequency	hertz	Hz	1 Hz = 1 c/s(s ⁻¹)
Electric conductance	siemens	S	1 S = 1 A/V
Electromotive force	volt	V	1 V = 1 W/A
Pressure, stress	pascal	Pa	1 Pa = 1 N/m ²



INDIAN STANDARDS INSTITUTION

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, NEW DELHI 110002

Telephones: 331 01 31, 331 13 75

Telegrams: Manaksanstha
(Common to all offices)

Regional Offices:

Telephone

*Western : Manakalaya, E9 MIDC, Marol, Andheri (East), 6 32 92 95
BOMBAY 400093

†Eastern : 1/14 C.I.T. Scheme VII M.V.I.P. Road, 36 24 99
Maniktola, CALCUTTA 700054

Northern : SCO 445 - 446, Sector 35 - C, { 2 18 43
CHANDIGARH 160036 { 3 16 41

Southern : C.I.T. Campus, MADRAS 600113 { 41 24 42
{ 41 25 19
{ 41 29 16

Branch Offices:

'Pushpak', Nurmohamed Shaikh Marg, Khanpur, { 2 63 48
AHMADABAD 380001 { 2 63 49

'F' Block, Unity Bldg, Narasimharaja Square, 22 48 05
BANGALORE 560002

Gangotri Complex, Bhadbhada Road, T. T. Nagar, 6 67 16
BHOPAL 462003

Plot No. 82/83 Lewis Road, BHUBANESHWAR 751002 5 36 27

53/5 Ward No. 29, R.G. Barua Road, 5th Byelane, —
GUWAHATI 781003

5-8-56C L. N. Gupta Marg, HYDERABAD 500001 22 10 83

R14 Yudhister Marg, C Scheme, JAIPUR 302005 { 6 98 32
{ 6 34 71

117/418 B Sarvodaya Nagar, KANPUR 208005 21 82 92

Patliputra Industrial Estate, PATNA 800013 6 23 05

Hantex Bldg (2nd Floor), Railway Station Road, 52 27
TRIVANDRUM 695001

Inspection Office (With Sale Point):

Institution of Engineers (India) Building, 1332 Shivaji Nagar, 5 24 35
PUNE 411005

*Sales Office in Bombay is at Novelty Chambers, Grant Road, 89 65 28
Bombay 400007

†Sales Office in Calcutta is at 5 Chowringhee Approach, P. O. Princep 27 68 00
Street, Calcutta 700072